



**BATHROOM PLAN**

SCALE 1/2" = 1'-0"

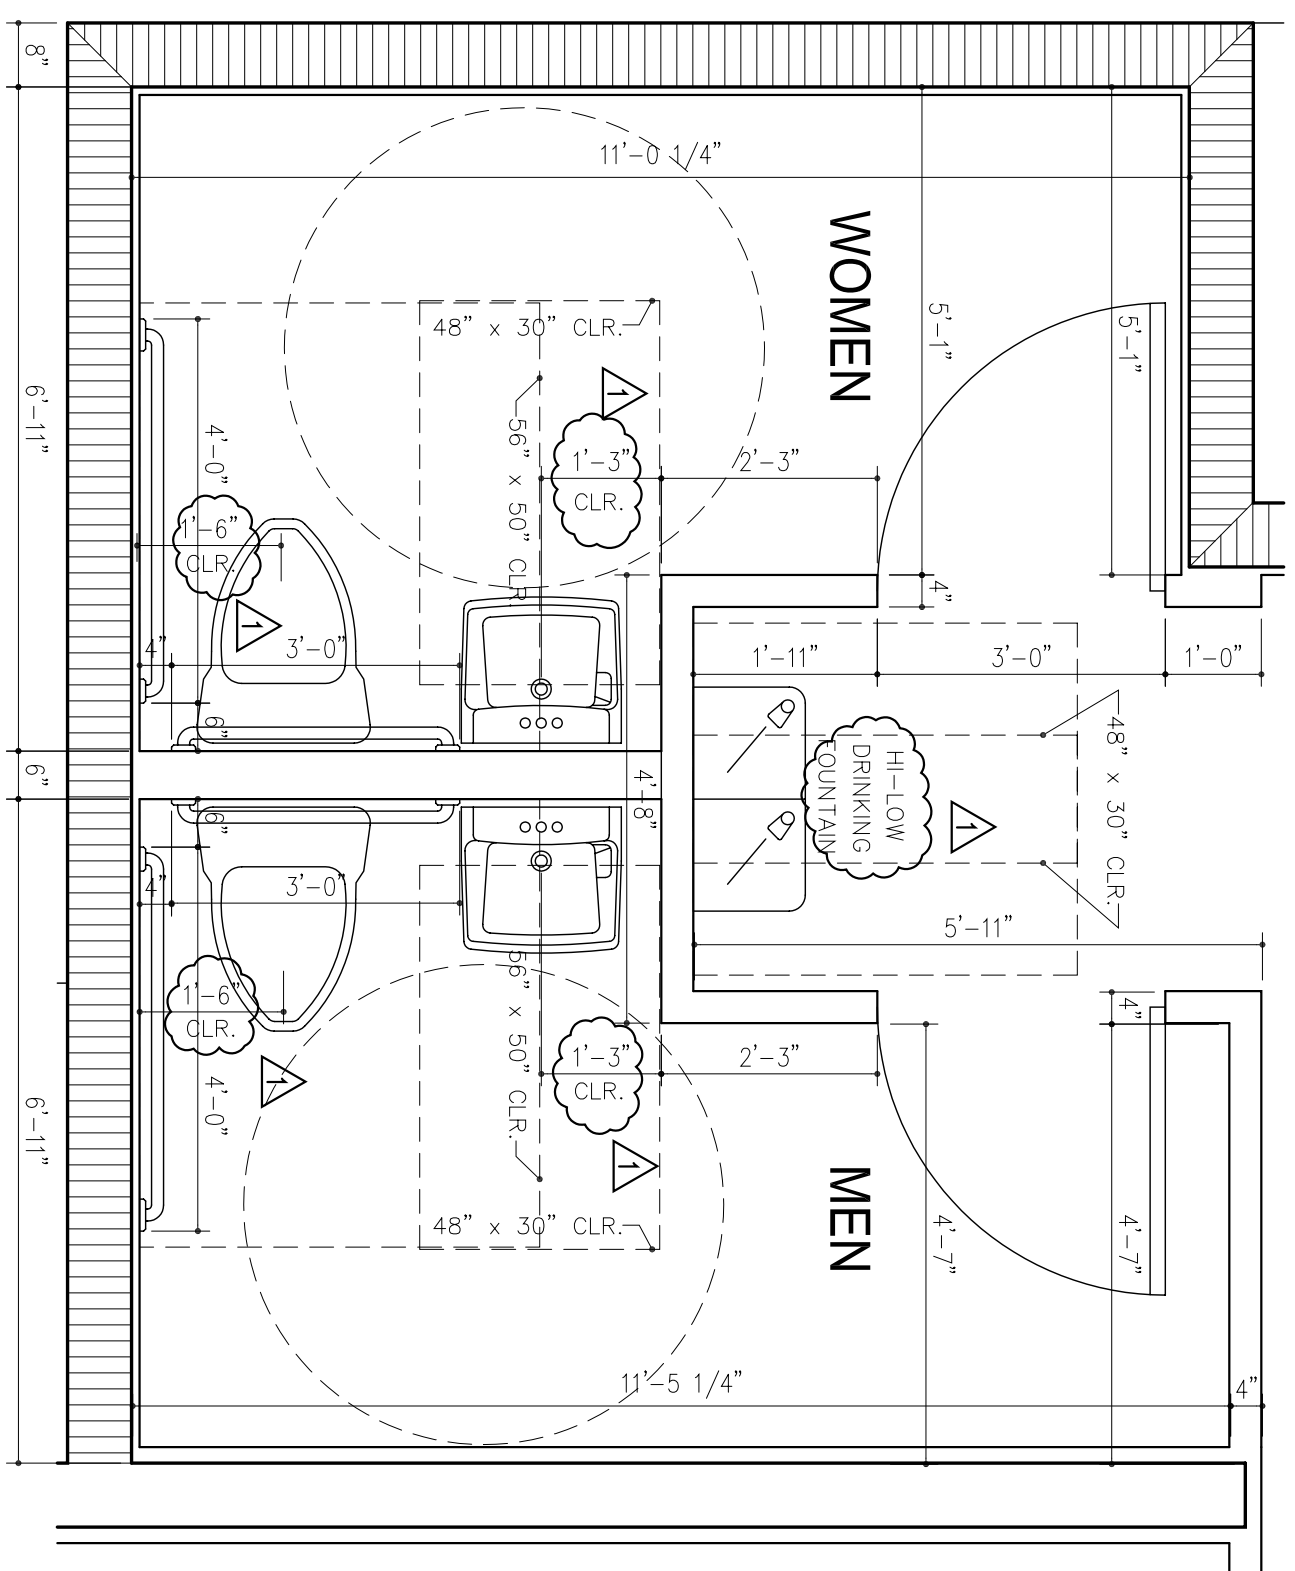

**BATHROOM PLAN**

SCALE 1/2" = 1'-0"

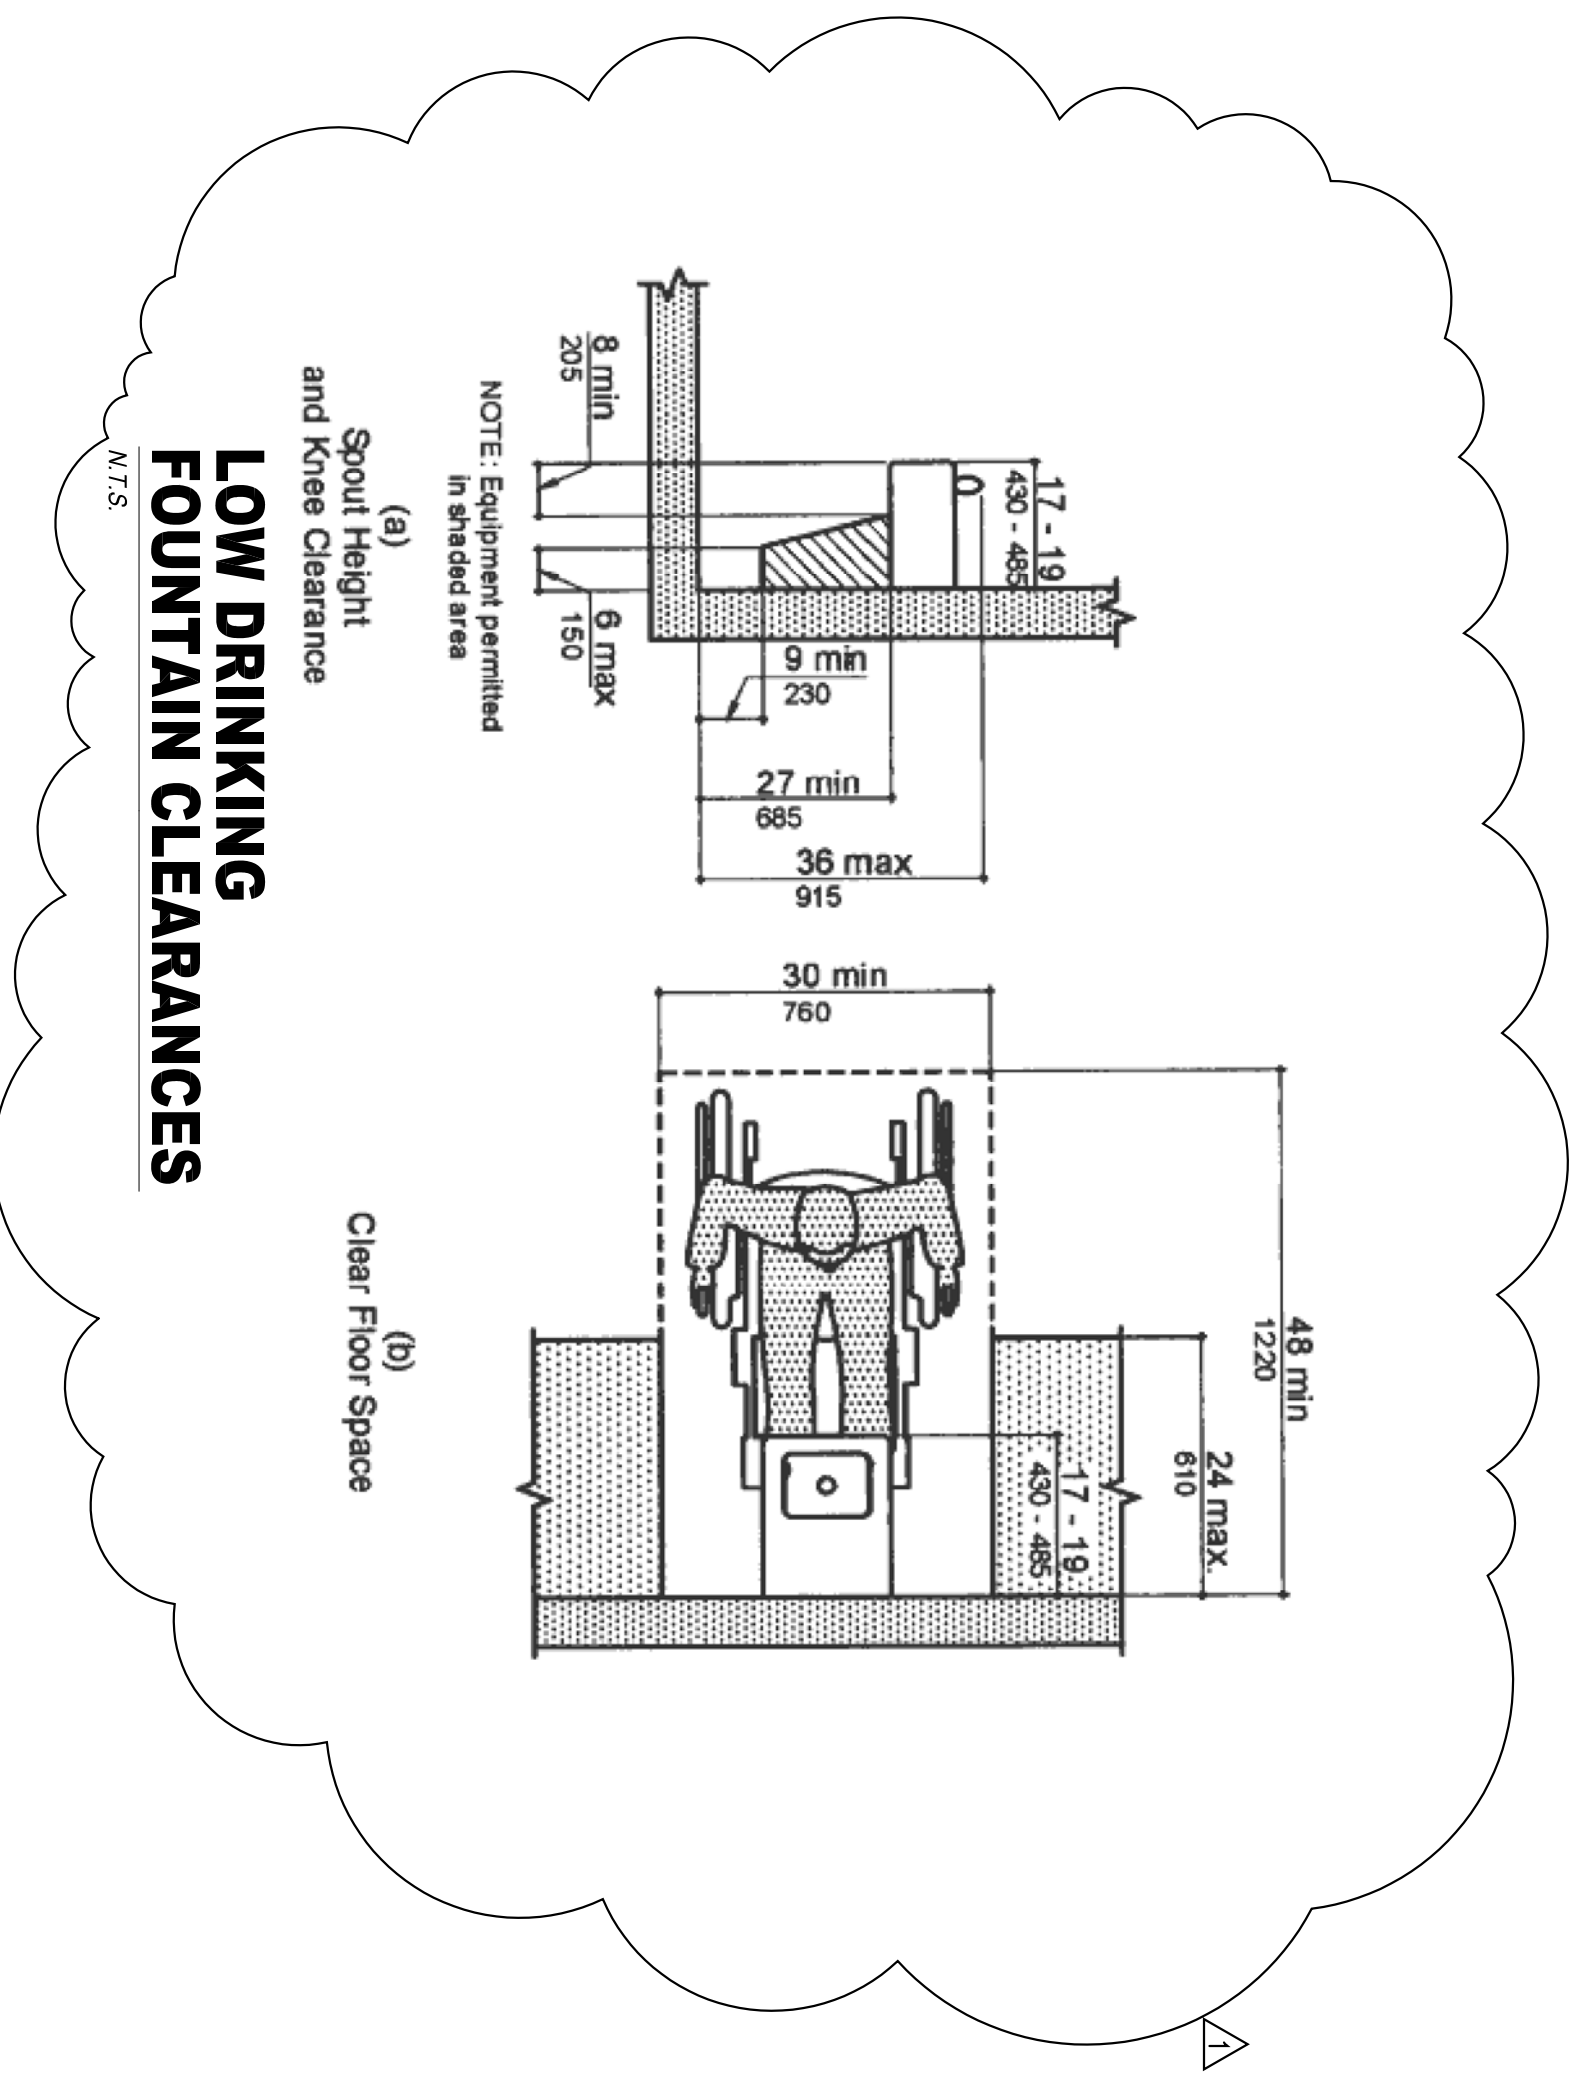

**LOW DRINKING FOUNTAIN CLEARANCES**

Spout Height and Knee Clearance

Clear Floor Space

NOTE: Equipment permitted in shaded area

N.T.S.

**ASSUMPTIONS**

1. ACCESSIBLE WATER CLOSET DEPTH IS 30 INCH CLEAR WIDTH AND IT IS FLOORED MOUNTED.
2. CONTROLS FOR FLUSH VALVES SHALL BE ON THE WIDE SIDE OF THE TOILET AREAS (FAGBC 11.4.16.5).
3. ACCESSIBLE TOILET STALL DOOR IS IN COMPLIANCE WITH FAGBC 11.4.17.1 AND 11.4.17.2.
4. TOILET ACCESSORIES TO BE APPROVED.
5. PROVIDE MIRRORS SHALL BE MOUNTED WITH THE BOTTOM EDGE OF THE FINISH FLOOR.
6. HOT WATER AND DRAIN PIPES UNDER LAVATORIES SHALL BE INSULATED OR OTHERWISE CONFIGURED TO PROTECT AGAINST CONTACT. THERE SHALL BE NO SHARP OR ABRASIVE SURFACE UNDER LAVATORIES.

NOTE:  
ACCESSIBILITY TOILET STALL (COMPARTMENT) CAN BE 56" IN DEPTH IF YOU HAVE A WALL MOUNTED WATER CLOSET. IF THE DEPTH OF A STANDARD ACCESSIBLE TOILET STALL IS 56" (MINIMUM) AND THE WALL MOUNTED WATER CLOSET MAY BE USED. WE RECOMMEND A DEPTH OF 60" (11.4.17.3).

THE CERAMIC TILES IN THE TOILET ROOMS SHALL BE NON-SLIP (NON-GLAZED) AND NON-ABSORBENT TILES. SLOPED TO FLOOR DRAIN. THE INTER SECTION BETWEEN THE FLOOR AND WALL SHALL BE COVERED. TILES ON WALLS SHALL BE INSTALLED TO A MIN. HEIGHT OF 4'-0" ABOVE THE FIN.

\*\* THE SINK SHALL BE A MINIMUM OF 15 INCHES FROM THE WALLS REQUIRED BY SECTION 11.4.16.5. \*\*  
\*\* FLOOR MOUNTED WATER CLOSET MAY BE USED FOR BATHROOM ELEVATIONS REFER TO A-9.3 THRU A-9.5