

LOW DRINKING FOUNTAIN CLEARANCES

Spout Height and Knee Clearance


Clear Floor Space

** THE SINK SHALL BE A MINIMUM OF 15 INCHES FROM THE WALLS REQUIRED BY SECTION 109.3.1 OF THE FPC FLOOR MOUNTED WATER CLOSET MAY BE USED FOR BATHROOM ELEVATIONS REFER TO A-9.3 THRU A-9.5

- ASSUMPTIONS:
1. ACCESSIBLE WATER CLOSET DEPTH IS 30 INCH CLEAR WIDTH AND IT IS FLOORED MOUNTED.
 2. CONTROLS FOR FLUSH VALVES SHALL BE ON THE WIDE SIDE OF THE TOILET AREAS (FAGBC 11.4.16.5).
 3. ACCESSIBLE TOILET STALL DOOR IS IN COMPLIANCE WITH FAGBC 11.4.16.10.
 4. TOILET ACCESSORIES TO BE APPROVED.
 5. PROVIDE MIRRORS SHALL BE MOUNTED WITH THE BOTTOM EDGE OF THE FINISH FLOOR.
 6. HOT WATER AND DRAIN PIPES UNDER LAVATORIES SHALL BE INSULATED OR OTHERWISE CONFIGURED TO PROTECT AGAINST CONTACT. THERE SHALL BE NO SHARP OR ABRASIVE SURFACE UNDER LAVATORIES.


NOTE: ACCESSIBILITY TOILET STALL (COMPARTMENT) CAN BE 56" IN DEPTH IF YOU HAVE A WALL MOUNTED WATER CLOSET. IF THE DEPTH OF A STANDARD ACCESSIBLE TOILET STALL IS 60" (MINIMUM) A FLOOR MOUNTED WATER CLOSET MAY BE USED. WE RECOMMEND A DEPTH OF 60" (11.4.17.3).

THE CERAMIC TILES IN THE TOILET ROOMS SHALL BE NON-SLIP (NON-GLAZED) AND NON-ABSORBENT TILES. SLOPED TO FLOOR DRAIN. THE INTERSECTION BETWEEN THE FLOOR AND WALL SHALL BE COVERED. TILES ON WALLS SHALL BE INSTALLED TO A MIN. HEIGHT OF 4'-0" ABOVE THE FIN.

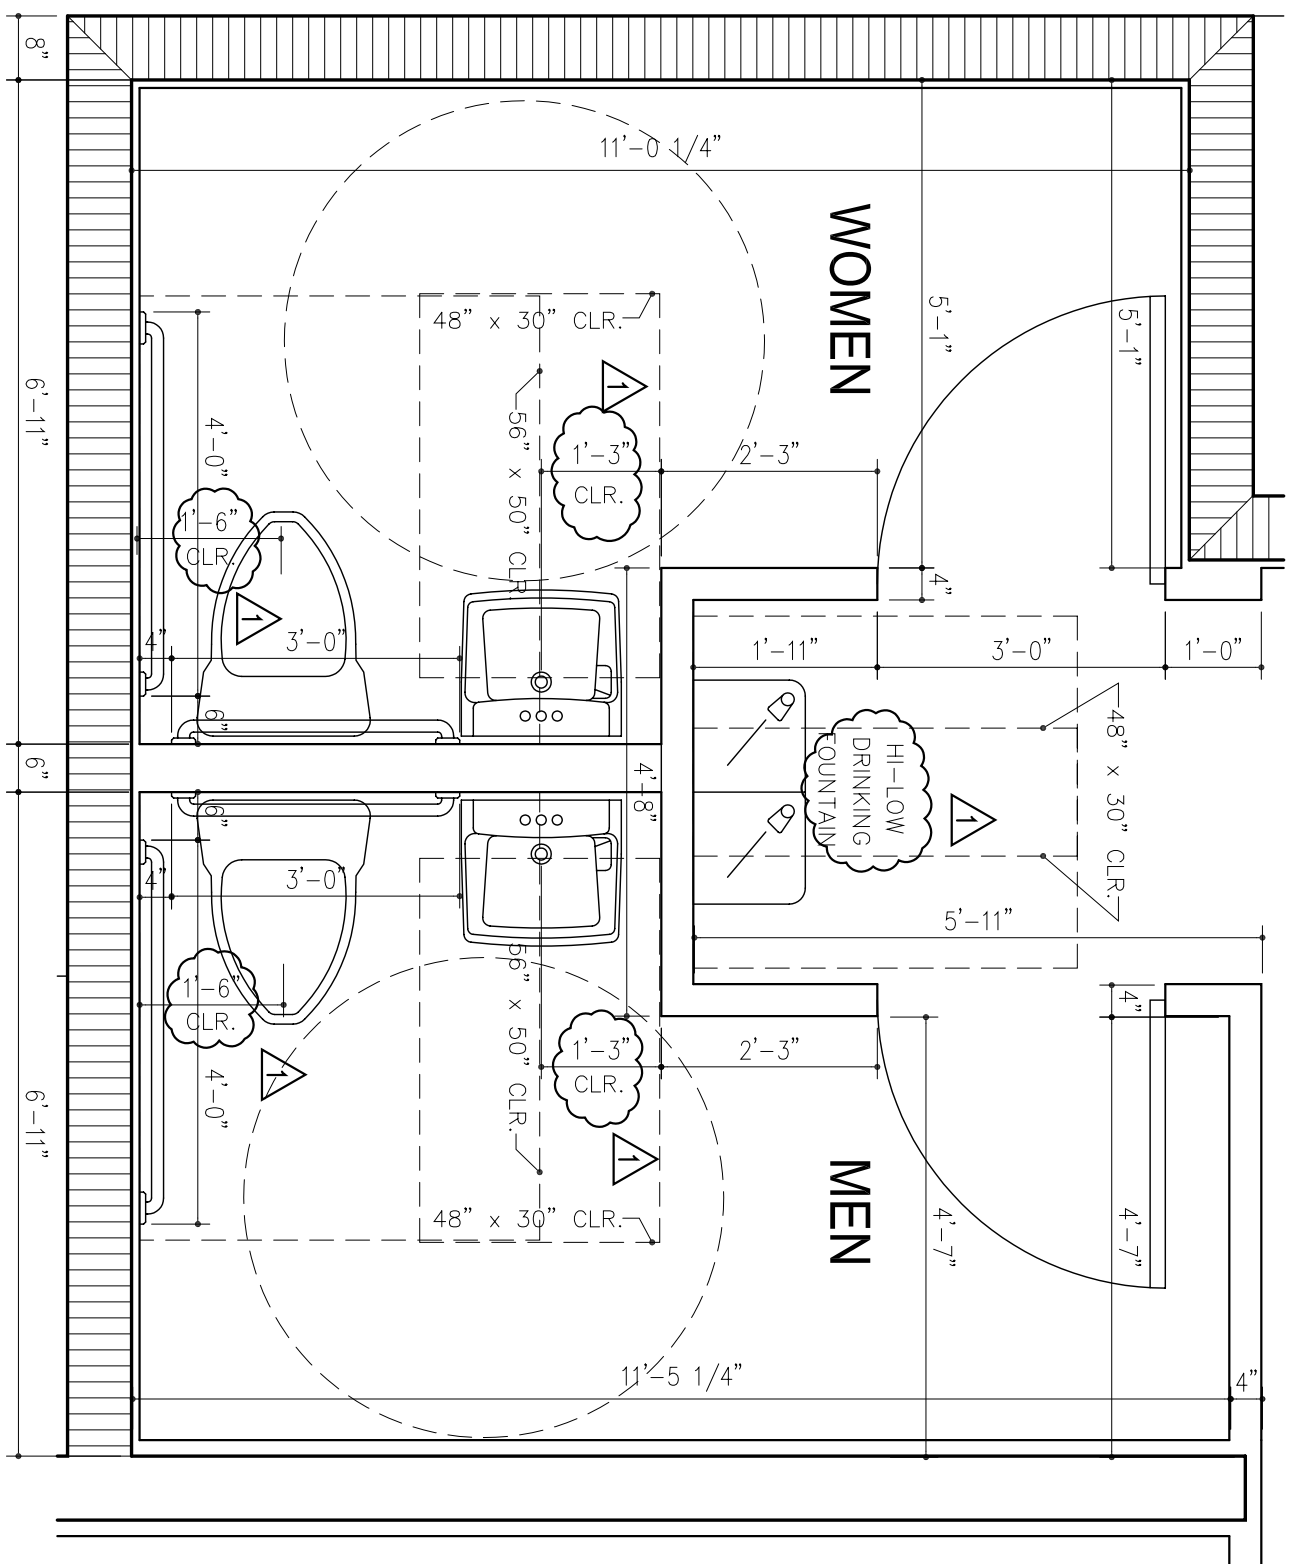

2 BATHROOM PLAN

SCALE: 1/2" = 1'-0"

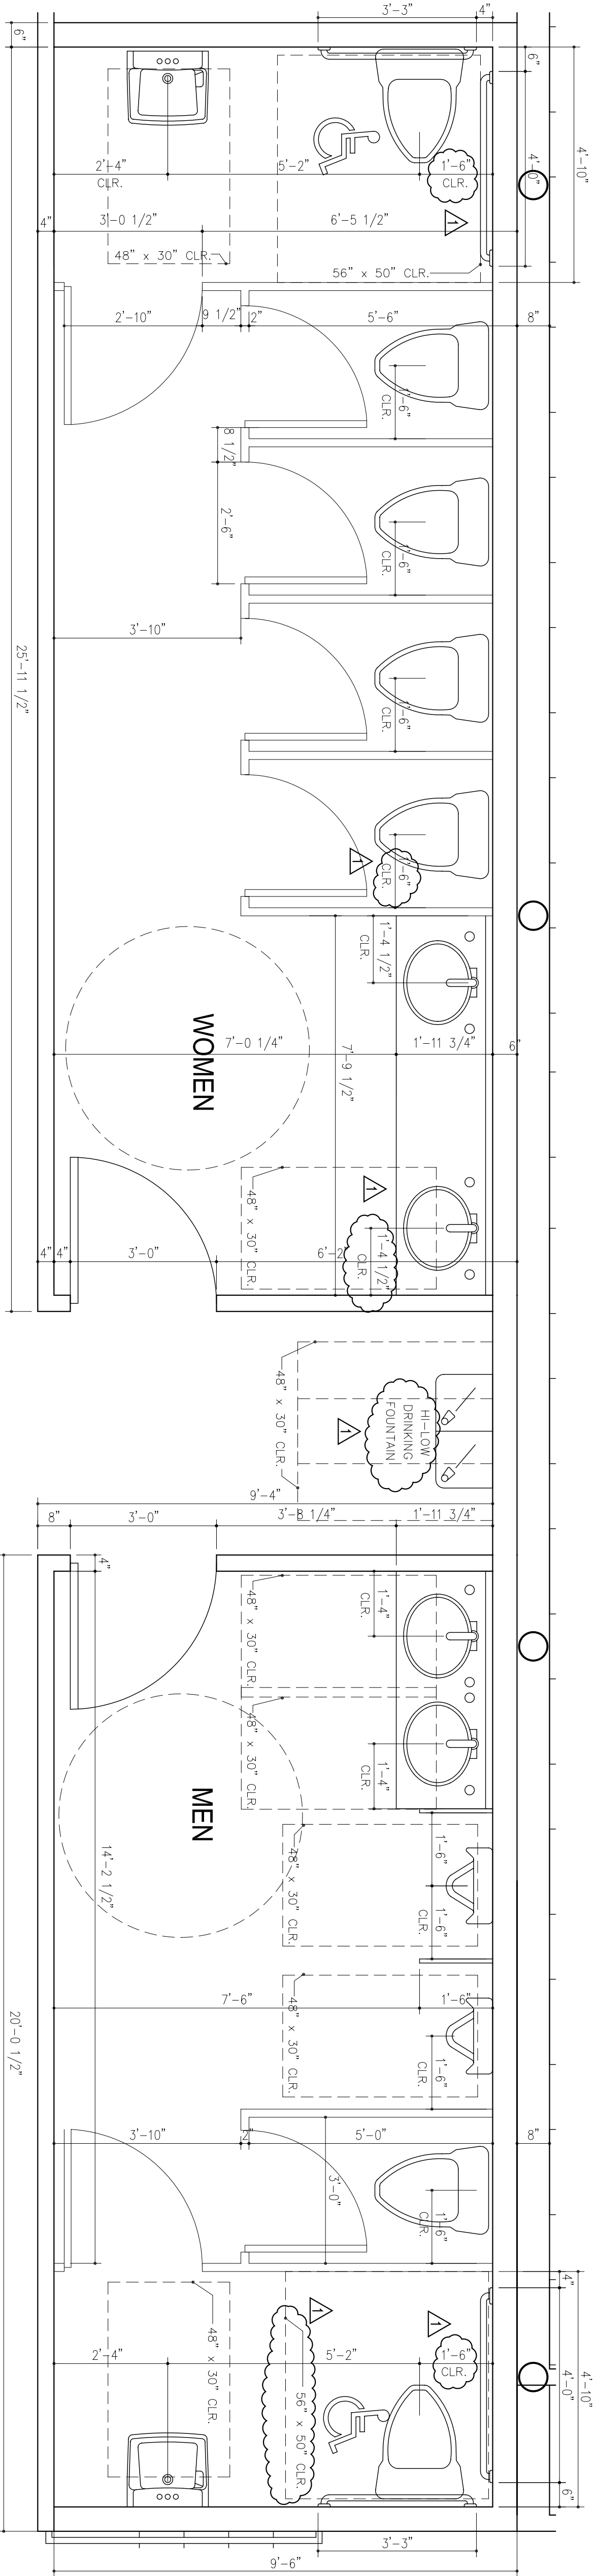

1 BATHROOM PLAN

SCALE: 1/2" = 1'-0"

FIRST HAITIAN FREE CHURCH OF NAZARENE

First Haitian Free Church of Nazarene by Faith
ORLANDO, FLORIDA

RAMOSMARTINEZ
ARCHITECTS, INC. AA 26000528

MIAMI: 305-548-3008, 305-548-3220, www.marq.com
FACSIMILE: 305-548-3220
WEBSITE: www.marq.com
NEW YORK: 11 ERIE STREET, JERSEY CITY, NJ 07302

BATHROOM PLANS
ORANGE BLOSSOM TRAIL
ORLANDO, FLORIDA

DATE: 07/24/2008
DRAWN BY: [Signature]
CHECKED BY: [Signature]

A-9.1