

POWER PLAN—
BASEMENT LEVEL

SCALE: 3/16" = 1'-0"

NOTES (APPLIES TO THIS DRAWING ONLY):


1. FOR THE MECHANICAL EQUIPMENT (FAN COIL UNITS, EXHAUST FANS, ETC.) THE EC SHALL REFER TO THE MECHANICAL EQUIPMENT CONNECTION SCHEDULE ON DRAWING E6 AND PROVIDE AND INSTALL MATERIALS AS SCHEDULED THERE.
2. NEW TELEPHONE SERVICE POINT; EC SHALL PROVIDE AND INSTALL A (4'x4'x3/4" PLYWOOD) TELECOMM BACKBOARD IN THE ROOM INDICATED. ALL TELEPHONE WIRING BACK TO THIS BOARD SHALL BE BY OWNER OR OWNER SELECTED VENDOR.
3. MAIN PANEL "MDP"; LOCATE ON INTERIOR OF BUILDING IN THE MAIN ELECTRICAL ROOM AS SHOWN. LOCATE UTILITY METER ON THE POLE AT THE BASE OF THE POLE MOUNTED TRANSFORMER. EC SHALL COORDINATE THE EXACT TRANSFORMER LOCATION AND METER LOCATION WITH UTILITY COMPANY PRIOR TO INSTALLATION AND ADJUST LOCATIONS ACCORDINGLY.
4. UNDERGROUND SECONDARY FEEDER FROM UTILITY COMPANY POLE MOUNTED TRANSFORMER TO THE MAIN BREAKER DISCONNECT LOCATED WITHIN MAIN PANEL "MDP"; SEE DRAWING E4 FOR FEEDER DESCRIPTION. EC TO INSTALL CONDUIT, CONDUCTORS, AND COORDINATE UTILITY COMPANY TERMINATIONS AT PAD MOUNT TRANSFORMER.
5. FROM JUST BELOW TELECOMM BACKBOARD, THE EC SHALL PROVIDE AND INSTALL TWO (2) 4" UNDERGROUND PVC CONDUITS OUT UNDERGROUND TO THE TELEPHONE SERVICE CONNECTION POINT. EC SHALL COORDINATE THE EXACT CONDUIT TERMINATION POINT WITH TELEPHONE COMPANY.
6. EC SHALL PROVIDE AND INSTALL MATERIALS AS INDICATED ON TRANSFORMER PAD AND PAD GROUNDING DETAILS SHOWN ON DRAWING E6, DETAILS #1 AND #3.
7. DEDICATED POWER CIRCUIT AND TELEPHONE LINE FOR FIRE ALARM SYSTEM INSTALLED ON WALL ABOVE PANEL; WIRE DEDICATED CIRCUIT "A-30" TO THE FIRE ALARM J-BOX AND USE 2 #12 4 1/2 GND. IN 1/2" EMT CONDUIT. FIRE ALARM CONTROL/ANNUNCIATOR PANEL SHALL BE SURFACE MOUNTED. ANNUNCIATOR PANEL IN FOYER SHALL BE RECESS MOUNTED.
8. LOCATE SMOKE DETECTORS PER ARCHITECTURAL REFLECTED CEILING PLAN WHICH HAS BEEN COORDINATED WITH LOCATION OF DETECTORS SHOWN HERE; PRIORITY OF LOCATION IS LIGHTS FIRST, THEN HVAC DIFFUSERS, AND FINALLY SMOKE DETECTORS.

ricky jack/design
 25 HEMLOCK RIDGE ROAD
 LEICESTER, NORTH CAROLINA 28748
 PH: 828-683-7348 FAX: 828-683-9902
 email: rick@rickjackdesign.com

REVISIONS

1	
2	
3	
4	
5	

THE DESIGN AND/OR SPECIFICATIONS AS SHOWN ON THIS DRAWING AND/OR COMES THEREOF ARE THE EXCLUSIVE PROPERTY OF THE ARCHITECT. IN ACCORDANCE WITH ALL COPYRIGHT LAWS, ANY USE OF THIS DRAWING AND/OR COPYING WITHOUT WRITTEN PERMISSION OF THE ARCHITECT IS PROHIBITED.

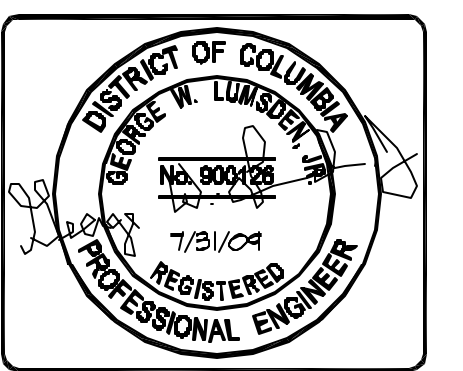

new facility for:
 washington
 seventh day
 baptist church
 CRITTENDEN @ 16TH, WASHINGTON, D.C.

project no. 2K70609	
dwn by: TC	chk by: GWL
date: JULY 31, 2009	
scale: AS SHOWN	
sheet no: E5	